


Alternative Structural Protection in Lieu of Meter Cover

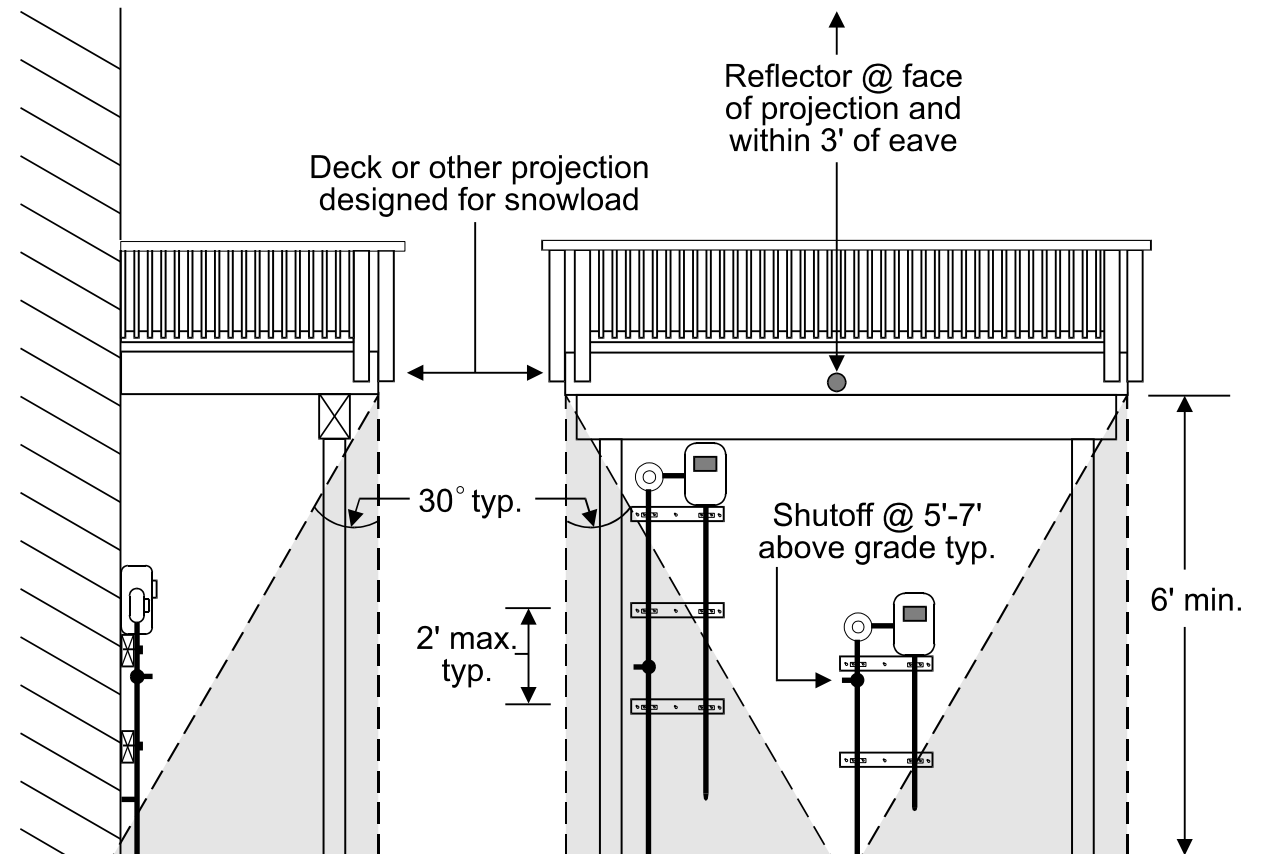

Meter and/or regulator may not be located within shaded areas. This area is determined by projecting a line 30° (degrees) from vertical at the front and sides of the projection. Piping may be located within the shaded areas. However, all piping must be supported and secured at 2' (foot) maximum intervals.